



**FORT COLLINS • LOVELAND
WATER DISTRICT**

2023 Annual Drinking Water Quality Report


(for calendar year 2022)

5150 Snead Dr., Fort Collins, CO 80525 - www.FCLWD.com - Phone: (970) 226-3104 - <https://www.facebook.com/FCLWD/>

Dear Customers of the Fort Collins– Loveland Water District,

We're pleased to send you the District's water quality report for 2022. In this report, we share with you information about your drinking water quality and interesting facts about the District. Our constant goal is to provide you with a safe and dependable supply of drinking water.

The District continues to grow at a moderate rate and sales of new taps reached 561 in 2022. We do not anticipate any water restrictions in 2023.

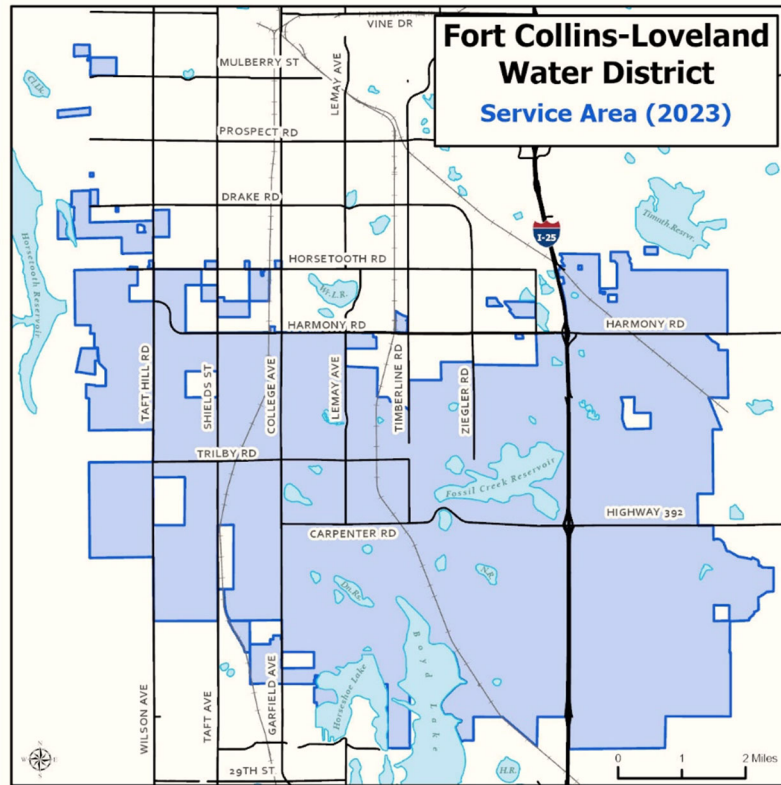

We continue to look forward to serving you and invite you to attend the monthly meetings of your Board of Directors. The meetings are held at the District office at 5150 Snead Drive on the third Tuesday of every month starting at 7:00PM.

As a reminder, our office hours are Monday-Friday, 8:00 to 4:30 with after hours on call. You can also contact us at 970-226-3104. If you have any questions regarding this report, please call the District Manager at 970-226-3104 extension 101.

YOUR DRINKING WATER MEETS ALL STATE AND FEDERAL STANDARDS

The Fort Collins–Loveland Water District (FCLWD) is committed to providing our customers with a safe and dependable supply of drinking water. Throughout 2022, we met all state and federal health standards.

WHERE DOES YOUR WATER COME FROM?

The water delivered to you by the Fort Collins-Loveland Water District (FCLWD) comes from the Soldier Canyon Water Treatment Authority (SCWTA) and the City of Fort Collins, which pull from the Poudre River and Horsetooth Reservoir. The SCWTA water treatment plant is owned and operated by the FCLWD, the East Larimer County Water District and the North Weld County Water District. The FCLWD sometimes purchases water from the City of Loveland during summer demand, and may come from North Weld County during emergencies. Fort Collins-Loveland Water District sells water to the Town of Windsor, the City of Loveland, Spring Canyon Water and Sanitation District and the Little Thompson Water District.

<u>Sources (Water Type – Source Type)</u>
PURCHASED WATER CO0135485 (Surface Water-Consecutive Connection) City of Loveland
PURCHASED WATER CO0162553(Surface Water-Consecutive Connection) North Weld County Water District
PURCHASED WATER CO0135718 (Surface Water-Consecutive Connection) Soldier Canyon Filter Plant
PURCHASED WATER CO0135291 (Surface Water-Consecutive Connection) City of Fort Collins

SOURCE WATER ASSESSMENT AND PROTECTION (SWAP)

SOLDIER CANYON WATER TREATMENT AUTHORITY CO0135718 & WELD COUNTY CO0162553

The Colorado Department of Public Health and Environment (CDPHE) has provided us with a Source Water Assessment Report for our water supply. You may obtain a copy of the report by visiting www.colorado.gov/cdphe/ccr. The Report is located under Guidance “Source Water Assessment Reports”. Search the table using 135718 Soldier Canyon Filter Plant, or by contacting Ken Garrett at 970-482-3143. The Source Water Assessment Report provides a screening level evaluation of potential contamination that COULD occur. It Does Not mean that the contamination HAS or WILL occur.

We can use this information to evaluate the need to improve our current water treatment capabilities and prepare for future contamination threats. This can help us ensure that quality finished water is delivered to your homes. In addition, the source water assessment results provide a starting point for developing a source water protection plan. Potential sources of contamination in our source water are listed below. Potential sources of contamination in our source water area may come from: (Low Susceptibility to) EPA hazardous waste generators, commercial/Industrial/ Transportation, low intensity residential, urban recreational grasses, row crops, fallow, pasture/hay, mixed forest, & oil/gas wells, (Moderately Low Susceptibility to) Solid waste sites, deciduous forest, evergreen forest, septic systems, road miles, (Moderate Susceptibility to) EPA chemical inventory/storage sites, EPA toxic release inventory sites, permitted wastewater discharge sites, & other facilities, (Moderately High Susceptibility to) Aboveground, underground, leaking storage tank sites, and existing/abandoned mine sites.

SOURCE WATER ASSESSMENT AND PROTECTION (SWAP) CITY OF FORT COLLINS CO0135291

The City of Fort Collins completed a Source Water Protection Plan (SWPP) in 2016. The SWPP found that the highest potential threats of pollution to the Cache la Poudre River and Horsetooth Reservoir are past and future wildfires, and historical mining. A follow-up report on mining in these watersheds determined that the risk of contamination from historical mining is low. To obtain a copy of either report, contact City of Fort Collins at 970-221-2900 V/TDD 711.

The Colorado Department of Public Health and Environment may have provided us with a Source Water Assessment Report for our water supply. For general information or to obtain a copy of the report please visit www.colorado.gov/cdphe/ccr. The report is located under “Guidance: Source Water Assessment Reports”. Search the table using 135291, FT COLLINS CITY OF, or by contacting City Of Fort Collins at 970-221-2900 V/TDD 711. The Source Water Assessment Report provides a screening-level evaluation of potential contamination that could occur. It does not mean that the contamination has or will occur. We can use this information to evaluate the need to improve our current water treatment capabilities and prepare for future contamination threats. This can help us ensure that quality finished water is delivered to your homes. In addition, the source water assessment results provide a starting point for developing a source water protection plan. Potential sources of contamination in our source water are EPA Hazardous Waste

Generators, EPA Chemical Inventory/Storage Sites, EPA Toxic Release Inventory Sites, Permitted Wastewater Discharge Sites, Aboveground, Underground and Leaking Storage Tank Sites, Solid Waste Sites, Existing/Abandoned Mine Sites, Concentrated Animal Feeding Operations, Other Facilities, Commercial/Industrial/Transportation, Low Intensity Residential, Urban Recreational Grasses, Row Crops, Fallow, Pasture/Hay, Deciduous Forest, Evergreen Forest, Mixed Forest, Septic Systems, Oil/Gas Wells, Road Miles.

Please contact us to learn more about what you can do to help protect your drinking water sources, any questions about the Drinking Water Quality Report, to learn more about our system, or to attend scheduled public meetings. We want you, our valued customers, to be informed about the services we provide and the quality water we deliver to you every day.

SOURCE WATER ASSESSMENT AND PROTECTION (SWAP) CITY OF LOVELAND CO0135485

The Colorado Department of Public Health and Environment may have provided us with a Source Water Assessment Report for our water supply. For general information or to obtain a copy of the report, please visit www.colorado.gov/cdphe/ccr. The report is located under “Guidance: Source Water Assessment Reports”. Search the table using 135485, LOVELAND CITY OF, or by contacting JEFF MONSON at 970-667-4416. The Source Water Assessment Report provides a screening-level evaluation of potential contamination that ***could*** occur. It ***does not*** mean that the contamination ***has or will*** occur. We can use this information to evaluate the need to improve our current water treatment capabilities and prepare for future contamination threats. This can help us ensure that quality finished water is delivered to your homes. In addition, the source water assessment results provide a starting point for developing a source water protection plan. Potential sources of contamination in our source water are EPA Hazardous Waste Generators, EPA Chemical Inventory/Storage Sites, EPA Toxic Release Inventory Sites, Permitted Wastewater Discharge Sites, Aboveground, Underground and Leaking Storage Tank Sites, Solid Waste Sites, Existing/Abandoned Mine Sites, Concentrated Animal Feeding Operations, Other Facilities, Commercial/Industrial/Transportation, Low Intensity Residential, Urban Recreational Grasses, Row Crops, Fallow, Pasture/Hay, Deciduous Forest, Evergreen Forest, Mixed Forest, Septic Systems, Oil/Gas Wells, Road Miles.

Please contact us to learn more about what you can do to help protect your drinking water sources, any questions about the Drinking Water Quality Report, to learn more about our system, or to attend scheduled public meetings. We want you, our valued customers, to be informed about the services we provide and the quality water we deliver to you every day.

Detected Contaminants

The Fort Collins-Loveland Water District and the Soldier Canyon Filter Plant routinely monitor for contaminants in your drinking water according to Federal and State laws. The following table(s) show all detections found in the period of January 1 to December 31, 2022 unless otherwise noted. The State of Colorado requires us to monitor for certain contaminants less than once per year because the concentrations of these contaminants are not expected to vary significantly from year to year, or the system is not considered vulnerable to this type of contamination. Therefore, some of our data, though representative, may be more than one year old. Violations and Formal Enforcement Actions, if any, are reported in the last section of this report.

Note: Only detected contaminants sampled within the last 5 years appear in this report. If no tables appear in this section, then no contaminants were detected in the last round of monitoring.

Definitions of Terms Used In Report

Fort Collins - Loveland Water District - FCLWD ID#CO0135292
City of Fort Collins - FC ID# CO0135291 **Tri Districts/Soldier Canyon Filter Plant/TD, SCFP** - ID#CO0135718
City of Loveland/LVD-ID#CO0135485

Action Level (AL): The concentration of a contaminant, which, if exceeded, triggers treatment or other requirements, which a water system must follow.

Maximum Contaminant Level (MCL): The highest level of a contaminant allowed in drinking water. MCL's are set as close to the MCLGs as feasible using the best available treatment technology.

Maximum Contaminant Level Goal (MCLG): The level of a contaminant in drinking water, below which there is no known or expected risk to health. MCLGs allow for a margin of safety.

Maximum Residual Disinfectant Level (MRDL): The highest level of a disinfectant allowed in drinking water. There is convincing evidence that addition of a disinfectant is necessary for control of microbial contaminants.

Maximum Residual Disinfectant Level Goal (MRDLG): The level of a drinking water disinfectant, below which there is no known or unexpected risk to health. MRDLGs do not reflect the benefits of the use of disinfectants to control micro-bialcontaminants.

Nephelometric Turbidity Unit (NTU): A measure of the clarity of water. Turbidity in excess of 5 NTU is just noticeable to the average person.

Parts per billion (ppb) or Micrograms per liter (µg/l): One part per billion corresponds to one minute in 2,000 years or one penny in \$10,000,000.

Parts per million (ppm) or Milligrams per liter (mg/l): One part per million corresponds to one minute in two years or one penny in \$10,000.

PicoCuries per Liter (pCi/l): A measure of radioactivity in water.

Treatment Technique (TT): A treatment technique is a required process intended to reduce the level of a contaminant in drinking water.

Average of Individual Samples: The typical value.

Range: The lowest value to the highest value.

Gross Alpha, Including RA, Excluding RN & U: This is the gross alpha particle activity compliance value. It includes radium-226, but excludes radon 222 and uranium.

Violation: A failure to meet a Colorado Primary Drinking Water Regulation.

Formal Enforcement Action: An escalated action taken by the State (due to the number and/or severity of violations) to bring a non-compliant water system back into compliance by a certain time, with an enforceable consequence if the schedule is not met.

Health-Based: A violation of either a MCL or TT.

Non-Health-Based: A violation that is not a MCL or TT.

Variance and Exemptions (V/E): Department permission not to meet a MCL or treatment technique under certain conditions.

Compliance Value (No Abbreviation): Single or calculated value used to determine if regulatory contaminant level (e.g. MCL) is met. Examples of calculated values are the 90th Percentile, Running Annual Average (RAA) and Locational Running Annual Average (LRAA).

Sample Size (n): Number or count of values (i.e. number of water samples collected).

Not Applicable (N/A): Does not apply or not available.

Level 1 Assessment: A study of the water system to identify potential problems and determine (if possible) why total coliform bacteria have been found in our water system.

Level 2 Assessment: A very detailed study of the water system to identify potential problems and determine (if possible) why an E. coli MCL violation has occurred and/or why total coliform bacteria have been found in our water system on multiple occasions.

General Information

Esta informacion es importante, si no puede leerla, pidale a alguien que la traduzca, por favor

The sources of drinking water (both tap water and bottled water) include rivers, lakes, streams, ponds, reservoirs, springs, and wells. As water travels, over the surface of the land or through the ground, it dissolves naturally occurring minerals and, in some cases, radioactive material, and can pick up substances resulting from the presence of animals or from human activity. Contaminants that may be present in source water include:

- Microbial contaminants, such as viruses and bacteria that may come from sewage treatment plants, septic systems, agricultural livestock operations, and wild life.
- Inorganic contaminants salts and metals, which can be naturally occurring or result from urban storm water runoff, industrial or domestic wastewater discharges, oil and gas production, mining of farming
- Pesticides and herbicides that may come from a variety of sources, such as agriculture, urban stormwater runoff, and residential uses
- Radioactive contaminants can be naturally occurring or be the result of oil and gas production and mining activities.
- Organic chemical contaminants, including synthetic and volatile organic chemicals, which are by products of industrial processes and petroleum production, and also may come from gas stations, urban stormwater runoff, and septic systems.

“In order to ensure that tap water is safe to drink, the Colorado

Department of Public Health and Environment prescribes regulations that limit the amount of certain contaminants in water provided by public water systems. The Food and Drug Administration regulations establish limits for contaminants in bottled water that must provide the same protection for public health.”

“All drinking water, including bottled water, may reasonably be expected to contain at least small amounts of some contaminants. The presence of contaminants does not necessarily indicate that the water poses a health risk. More information about contaminants and potential health effects can be obtained by calling the Environmental Protection Agency’s Safe Drinking Water Hotline (1-800-426-4791) or by visiting <http://water.epa.gov/drink/contaminants>.

Some people may be more vulnerable to contaminants in drinking water than the general population. Immunocompromised persons, such as persons with cancer undergoing chemotherapy, persons who have undergone organ transplants, people with HIV/AIDS or other immune system disorders, some elderly, and infants can be particularly at risk for infections. These people should seek advice about drinking water from their health care providers. For more information about contaminants and potential health effects, or to receive a copy of the U.S. Environmental Protection Agency (EPA) and the U.S. Centers for Disease Control (CDC) guidelines on appropriate means to lessen the risk of infection by cryptosporidium and microbiological contaminants, call the EPA Safe Drinking Water Hotline at 1-800- 426-4791 or visit <http://water.epa.gov/drink/contaminants>.

Lead and Copper Sampled in the Distribution System

<i>Contaminant Name</i>		<i>Monitoring Period</i>	<i>90th Percentile</i>	<i>Number of Samples</i>	<i>Unit of Measure</i>	<i>Action Level</i>	<i>Sample Sites Above Action Level</i>	<i>90th Percentile Action Level Exceedance</i>	<i>Typical Sources</i>
Copper	FCLWD	1/12/2022-2/18/2022	0.14	60	ppm	1.3	0	No	Corrosion of household plumbing systems Erosion of natural deposits
Lead*	FCLWD	1/12/2022-2/18/2022	3	60	ppb	15	3	No	

Disinfectants Sampled in the Distribution System

TT Requirement: At least 95% of samples per period (month or quarter) must be at least 0.2 ppm **OR** if sample size is less than 40 no more than 1 sample is below 0.2 ppm.

Typical Sources: Water additive used to control microbes.

<i>Disinfectant Name</i>	<i>Time Period</i>	<i>Results</i>	<i>Number of Samples Below Level</i>	<i>Sample Size</i>	<i>TT/MRDL Violation</i>	<i>MRDL</i>	
Chlorine	FCLWD	December, 2022	Lowest Period Percentage samples meeting TT Requirement: 100%	0	60	No	4.0 ppm

Disinfection Byproducts (TTHMs, HAA5, and Chlorite) Sampled in the Distribution System

<i>Contaminant Name</i>	<i>Year</i>	<i>Average of Individual Samples</i>	<i>Range of Individual Samples (Lowest - Highest)</i>	<i>Number of Samples</i>	<i>Unit of Measure</i>	<i>MCL</i>	<i>MCLG</i>	<i>MCL Violation</i>	<i>Typical Sources</i>	
Chlorite	FCLWD	2021	0.36	0.17-0.44	6	ppb	1	0.8	No	By-Product of drinking water disinfection
	FC	2022	0.23	0.2-0.27	12					
	SCFP	2022	0.35	0.30-0.41	12					
	LVD	2022	0.04	0-0.11	3					
Total Haloacetic Acids (HAA5)	FCLWD	2022	23.23	17.1-33.5	32	ppb	60	N/A	No	
Total Trihalomethanes (TTHM)	FCLWD	2022	30.83	19.5-45.1	32	ppb	80	N/A	No	

***LEAD IN DRINKING WATER**

If present, elevated levels of lead can cause serious health problems (especially for pregnant women and young children). It is possible that lead levels at your home may be higher than other homes in the community as a result of materials used in your home's plumbing. If you are concerned about lead in your water, you may wish to have your water tested. When your water has been sitting for several hours, you can minimize the potential for lead exposure by flushing your tap for 30 seconds to 2 minutes before using water for drinking or cooking. Additional information on lead in drinking water, testing methods and steps you can take to minimize exposure is available from the Safe Drinking Water Hotline at 1-800-426-4791 or visit <http://www.epa.gov/safewater/lead>

Turbidity Sampled at the Entry Point to the Distribution System						
<i>Contaminant Name</i>	<i>Sample Date</i>	<i>Level Found</i>	<i>TT Requirement</i>	<i>TT Violation</i>	<i>Typical Sources</i>	
Turbidity	SCFP	Date/Month: March 24	Highest single measurement: 0.048 NTU	Maximum 1 NTU for any single measurement	No	Soil Runoff
		Month: Met All 12 Months	Lowest monthly percentage of samples meeting TT requirement for our technology: 100%	In any month, at least 95% of samples must be less than 0.3 NTU	No	
	FC	Date/Month: Jun	Highest single measurement 0.19 NTU	Maximum 1 NTU for any single measurement	No	
		Month: Dec	Lowest monthly percentage of samples meeting TT requirement for our technology: 100%	In any month, at least 95% of samples must be less than 0.3 NTU	No	
	LVD	Date/Month: Feb	Highest single measurement 0.173 NTU	Maximum 1 NTU for any single measurement	No	
		Month: Dec	Lowest monthly percentage of samples meeting TT requirement for our technology: 100%	In any month, at least 95% of samples must be less than 0.3 NTU	No	

Inorganic Contaminants Sampled at the Entry Point to the Distribution System										
Contaminant Name		Year	Average	Range Low-High	Number of Samples	Unit of Measure	MCL	MCLG	MCL Violation	Typical Sources
Barium	SCFP	2022	0.017	0.015 to 0.018	4	ppm	2	2	No	Discharge or drilling waste; Discharge from metal refineries; Erosion of natural deposits.
	LVD	2022	0.01	0.01 to 0.01	1	ppm	2	2	No	
	FC	2022	0.01	0.01 to 0.01	1	ppm	2	2	No	
Fluoride	SCFP	2022	0.62	0.58 to 0.67	4	ppm	4	4	No	Erosion of natural deposits; Water additive that promotes strong teeth; Discharge from fertilizer and aluminum factories.
	FC	2022	0.61	0.61 to 0.61	1	ppm	4	4	No	
	LVD	2022	0.73	0.73 to 0.73	1	ppm	4	4	No	
Nitrate	FC	2022	0.06	0.06 to 0.06	1	ppm	10	10	No	Runoff from fertilizer use; Leaching from septic tanks, sewer; Erosion of natural deposits.
	LVD	2022	0.3	0.3 to 0.3	1	ppm	10	10	No	
	SCFP	2022	0.05	0 to 0.13	4	ppm	10	10	No	

Total Organic Carbon (Disinfection By-Products Precursor) Percentage Removal Ratio of Raw & Finished Water									
Contaminant Name		Year	Average of Individual Ratio samples	Range of Individual Ratio Samples (Lowest-Highest)	Number of Ratio Samples	Unit of Measure	TT Minimum Ration	TT Violation	Typical Sources
Total Organic Carbon	SCFP	2022	1.11	1.01-1.20	12	Ratio	1	No	Naturally present in the environment
	FC	2022	1.26	1.05-1.62	12	Ratio	1	No	
	LVD	2022	1.43	1.22-1.64	12	Ratio	1	No	

Unregulated Contaminants Sampled In The Distribution System

EPA has implemented the Unregulated Contaminant Monitoring Rule (UCMR) to collect data for contaminants that are suspected to be present in drinking water and do not have health-based standards set under the Safe Drinking Water Act. EPA uses the results of UCMR monitoring to learn about the occurrence of unregulated contaminants in drinking water and to decide whether or not these contaminants will be regulated in the future. We performed monitoring and reported the analytical results of the monitoring to EPA in accordance with its Unregulated Contaminant Monitoring Rule (UCMR). Once EPA reviews the submitted results, the results are made available in the EPA's National Contaminant Occurrence Database (NCOD) (<http://www.epa.gov/dwucmr/national-contaminant-occurrence-database-ncod>). Consumers can review UCMR results by accessing the NCOD. Contaminants that were detected during our UCMR sampling and the corresponding analytical results are provided below.

<i>Contaminants Sampled In The Distribution System</i>					
<i>Contaminant Name</i>	<i>Year</i>	<i>Average</i>	<i>Range Low-High</i>	<i>Sample Size</i>	<i>Units of Measure</i>
BROMOCHLOROACETIC ACID	2018	1.07	0.401-1.61	4	ug/L
BROMODICHLOROACETIC ACID	2018	1.16	1.14-1.18	4	ug/L
DICHLOROACETIC ACID	2018	8.84	4.20-12.8	4	ug/L
TRICHLOROACETIC ACID	2018	16.43	15.5-17.4	4	ug/L
MANGANESE	2018	0.52	<0.400-1.03	2	ug/L

Secondary Contaminants**

Secondary standards are non-enforceable guidelines for contaminants that may cause cosmetic effects (such as skin/tooth discoloration) or aesthetic effects (ie. taste, odor, or color) in drinking water.

Contaminant Name		Year	Average	Range of Results	Sample Size	Unit of measure
Sodium	SCFP	2022	12.55	8.5-16.0	4	ppm
	LVD	2022	17	17-17	1	ppm
	FC	2022	2.81	2.81-2.81	1	ppm

Radionuclides Samples at the Entry Point to the Distribution System

Contaminant Name		Year	Average	Range Low-High	Sample Size	Units of Measure	MCL	MCLG	MCL Violation	Typical Sources
Combined Radium	LVD	2022	1.4	1.4 To 1.4	1	pCi/L	5	0	No	Erosion of Natural deposits

Violations, Significant Deficiencies, Backflow/Cross-Connection, and Formal Enforcement Actions

The CITY OF LOVELAND PWS ID: CO0135485 had the following Violation.

Non-Health-Based Violations		
These violations do not usually mean that there was a problem with the water quality. If there had been, we would have notified you immediately. We missed collecting a sample (water quality is unknown), we reported the sample result after the due date, or we did not complete a report/notice by the required date.		
Name	Description	Time Period
CHLORINE/CHLORAMINE	FAILURE TO MONITOR AND/OR REPORT	04/01/2022 - 04/30/2022

SOLDIER CANYON FILTER PLANT PWS ID CO0135718 had the following Violation.

Non-Health-Based Violations		
These violations do not usually mean that there was a problem with the water quality. If there had been, we would have notified you immediately. We missed collecting a sample (water quality is unknown), we reported the sample result after the due date, or we did not complete a report/notice by the required date.		
Name	Description	Time Period
CARBON, TOTAL	FAILURE TO MONITOR AND/OR REPORT	10/01/2022-12/31/2022

FORT COLLINS-LOVELAND WATER DISTRICT PWS ID CO0135292 had the following Violation.

Non-Health-Based Violations		
These violations do not usually mean that there was a problem with the water quality. If there had been, we would have notified you immediately. We missed collecting a sample (water quality is unknown), we reported the sample result after the due date, or we did not complete a report/notice by the required date.		
Name	Description	Time Period
NOTIFICATION OF TAMPERING	FAILURE TO MONITOR AND/OR REPORT	4/27/2022

IMPORTANT INFORMATION ABOUT YOUR DRINKING WATER

Fort Collins-Loveland Water District

Notification Requirements Not Met

Este informe contiene información muy importante sobre su agua potable. Tradúzcalo o hable con alguien que lo entienda bien.

Our water system recently violated a drinking water requirement. Although this situation is not a public health risk, as our customers you have a right to know what happened, what you should do, and what we are doing to correct this situation.

Due to extensive employee turnover the public notice was not sent out in time. Discussion and operating procedures have been adjusted to avoid future incidents. . We were required to notify the state drinking water program of the situation by April 26,2022, but we failed to do so.

We also failed to notify you of the violation/situation in a timely manner.

What does this mean? What should I do?

- There is nothing you need to do at this time. If a situation arises where the water is no longer safe to drink, you will be notified within 24 hours.

What is being done?

- On September 25, 2019, the District experienced a series of unexplained intrusion alarms at County Road 40-meter vault. An investigation was launched, and no intrusions could be verified. The District resolved the situation by adding security cameras to all of our facilities as soon as was possible. On June 14, 2020, an unknown individual/individuals opened a fire hydrant on South Shields Street. The fire hydrant was closed by on call personnel. After this incident fire hydrants in vulnerable areas, poorly lit or remote, were identified. The District then coordinated with local fire agencies and placed locks on the fire hydrants to deter tampering. The District received notice of the violation for failure to notify the CDPHE on April 26, 2022. A SOP was drawn up, and distributed to assure the situation is handled correctly in the future. A notice of the violation was sent to all customers with the 2023 CCR. This was completed on June 7, 2023.

We anticipate resolving the problem by **June 7, 2023**. For more information, please contact **Chris Dash** at **cdash@fclwd.com** or **970-226-3104 ext. 105**, or **5150 Snead Dr. Fort Collins CO 80525**.

Please share this information with all the other people who drink this water, especially those who may not have received this notice directly (for example, people in apartments, nursing homes, schools, and businesses). You can do this by posting this notice in a public place or distributing copies by hand or mail.

This notice is being sent to you by: Fort Collins-Loveland Water District - CO0135292
Date distributed: **June 7, 2023**